

LIGHT POLE FEED POINT WIRING


NO SCALE

PROVIDE METER SOCKET AND MOUNT IN ACCORDANCE WITH UTILITY COMPANY REQUIREMENTS.

1 1/2" L.B./GASKET COVER
CABINET ENCLOSURES - SEE SPEC.

2" RIGID GALVANIZED STEEL CONDUIT. CONDUIT TO EXTEND 18" BELOW GRADE. PROVIDE PLASTIC BUSHING.

(2) 1" PVC SCHEDULE 80 CONDUIT, 1 NO. 6 BARE COPPER. CONDUIT TO EXTEND 18" BELOW GRADE. PROVIDE PLASTIC BUSHING.

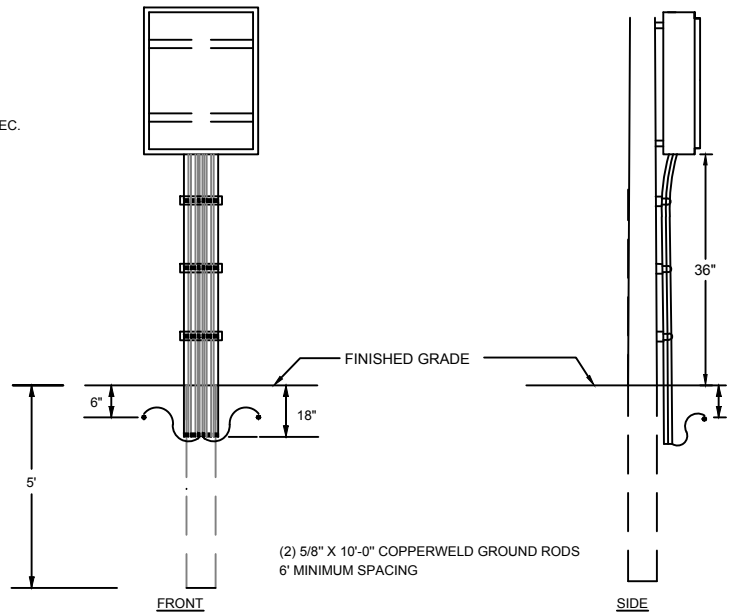

LIGHT POLE MOUNTED FEED POINT

NO SCALE

CITY OF WATFORD CITY, NORTH DAKOTA
PUBLIC WORKS DEPARTMENT

LIGHT POLE MOUNTED FEED POINT & FEED POINT WIRING

APPROVED FOR PUBLICATION

DWG. NO.

City Engineer _____ Date _____

1000-6